

Gen Set Robert Moore 125 KW with Waukesha Nat Gas Driver

ROBERT MORSE

CORP.
LTD.

MONTREAL, QUE.

MODEL

D 6 G 12 5

SERIAL

1 0 0

KW

6 2 5

KVA

6 5 6 . 2 5

VOLTS

5 0 0

AMPS.

1 5 0


REV/S/CYCLES

RPM

8 0 0

10-100



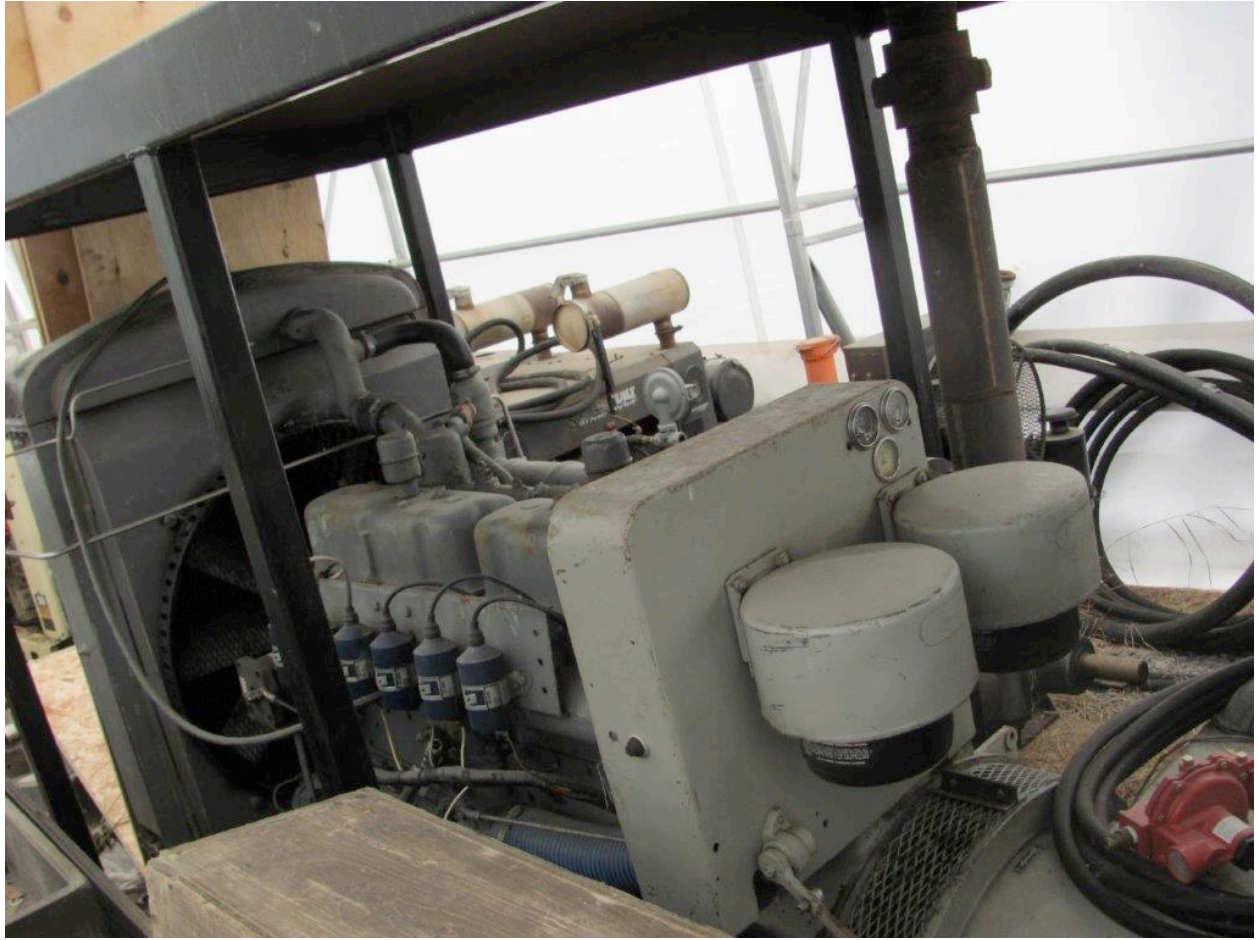

	K.V.A.	K.W.	R.P.M.	AMPS
	156.25	125	1800	347/600
MODEL NO.	B5036Y-3MS0DC-AM			
SERIAL NO.	5-161071-01	503		
TYPE	SG-864			FRAME SERVICE FACTOR
CYCLES	60	20.0		FIELD AMPS
PHASES	3	150		AMPS PER TERMINAL
ENCLOSURE	O.P.	0.8		POWER FACTOR
°C RISE				OVERLOAD
TIME DUTY	STANDBY			OVERLOAD DUTY
AMB °C	40			OVERLOAD °C RISE
BEARING FRONT END	312-SFFC			BEARING SHAFT END
EXCITER				
MODEL NO.	AMBY-PABLES	125		VOLTS
SERIAL NO.	5-161071-01	51		FIELD VOLTS
TYPE	BE-5	4.94		FIELD AMPS
 Tamper SYNCHRONOUS GENERATOR				



